

Product Data and Installation Guide



NFPA 96

IMC

1. Product Description - New and Improved FastWrap+

Thermal Ceramics new and improved FastWrap+ is a one-layer, totally foil-encapsulated, non-combustible 2000°F (1093°C) rated, low biopersistence, flexible fireproofing wrap specifically tested to provide a 1 or 2 hour fire rated enclosure for horizontal and vertical commercial kitchen grease and air ventilation ducts. The core blanket chemistry is alkaline-earth silicate wool free of binders and lubricants. FastWrap+ is classified by Omega Point Laboratories and Underwriter's Laboratories Listing and Follow-up Service Program to ensure uniform thickness and density specifications, thus providing consistency in end physical properties for required fire ratings. FastWrap+ is a proven performance alternative through extensive testing to 1 or 2 hour fire-resistance rated shaft enclosures. With its excellent insulating capability of withstanding fire condition temperatures up to 2000°F (1093°C), it protects combustible constructions at zero clearance throughout the entire enclosure system. When the duct penetrates fire rated walls and floors, an approved silicone firestop sealant used in combination with FastWrap+ provides an alternate means of protection to rigid shafts by maintaining the integrity of the 1 or 2 hour fire rated wall and floor assembly. FastWrap+ is resistant to mold growth in test conditions of 75-95% relative humidity (ASTM D6329).

Product Features

- One-layer system with 3 optional installation techniques
- Low biopersistent insulation blanket
- Does not contain low temperature fiberglass or mineral wool
- Shaft alternative to rigid board systems
- Zero clearance to combustibles protection throughout the entire enclosure system
- Lightweight, flexible wrap saves labor
- Passive fire proof material does not shrink, become brittle, or lose fire fighting capabilities with age
- Totally foil encapsulated system protects against material degradation, and potential fire hazards
- Product markings on foil ensure proper material identification for easy inspections
- Wide variety of through-penetration systems
- Resistant to mold growth

2. Applications

- 1 or 2 Hour Commercial Kitchen Grease Duct Enclosure
- 1 or 2 Hour Air Ventilation Duct Enclosure



3. Physical Characteristics

Duct FireMaster Fire Protection Product	Unit	Size	Units/ Ctn.	Wt./ Ctn.
FastWrap+	Roll	1½" x 24" x 25' (38.1 mm x 610 mm x 7.6 m)	1	37.5 lbs. (17 kg)
FastWrap+	Roll	1½" x 48" x 25' (38.1 mm x 1.2 m x 7.6 m)	1	75 lbs. (34 kg)
FastWrap+ Collar	Roll	1½" x 6" x 25' (38.1 mm x 152 mm x 7.6 m)	4	53 lbs. (24 kg)
Color	White blanket with silver foil encapsulation			

4. Specifications

This specification guide covers the application of Thermal Ceramics FastWrap+ Duct FireMaster Fire Protection Product and an approved silicone firestop sealant.

Application	Fire Resistive Rating	Enclosure System	Through Penetration System
Grease Ducts	1 or 2 hours	1 layer, 1½" FastWrap+, perimeter and longitudinal overlap 3" (75 mm), GD 544 F, GD 562 F, UL G-14	OPL FS 587F UL C-AJ-7098
Air Ducts	2 hours	1 layer, 1½" FastWrap+, perimeter and longitudinal overlap 3" (75 mm), UL V-19	C-AJ-7095, UL-W-L-7121 UL-F-C-7036 UL-F-C-7037

5. Performance

A. Thermal Ceramics FastWrap+ Duct FireMaster Fire Protection Product

Flammability (ASTM # 84/UL 723)		
Foil:	Flame spread	5
	Smoke developed	10
Blanket:	Flame spread	0
	Smoke developed	0
Thermal Resistance	R value per ASTM C 518 4.15 per inch at 70°F (21°C)	

B. Fire Stop Sealants

Tremco Inc.	Fyre Sil sealant or Fyre-Sil S/L Sealant (for floor assemblies only)
Specified Technologies Inc.	Pencil 300
Rectoseal	835+ Sealant
HILTI Construction Chemicals, Division of HILTI Inc.	FS One Sealant

6. Listings

Agency	Reference Standard/File No.
Omega Point Laboratories, Inc.	Listing # 11660-3
Underwriters Laboratory	Grease Duct Enclosures (HNKT): G-14; Fire Resistive Ventilation Duct Assemblies (HNLJ): V-19; Through- Penetration FireStop System (XHEZ): C-AJ-7095, C-AJ-7098
NFPA 96	Section 4.3.1, 2004 Edition
International Mechanical Code	Section 506.10.3 Commercial Kitchen Grease Ducts and Exhaust Equipment, Section 507 Commercial Kitchen Hoods, 2003 Edition
New York MEA	412-02-M, 413-02-M
International Code Council	SBCCI Legacy Report No. 9424E BOCA Legacy Report No. 22.25
City of Los Angeles	RR8425
California State Fire Marshal	2440-1361:103 2440-1361:105

7. Installation

A qualified contractor in accordance with manufacturer's instructions and referenced standards shall install the new or original FastWrap+ system using the installation methods as described in sections A-D. See Figures 1 - 4 complete drawing details.

Materials and Equipment:

FastWrap+ blanket, 1½" (38.1 mm) thick, 6 pcf (96 kg/m³), 24" (600 mm), or 48" (1.2 m) wide, and 25' (7.6 m) long rolls; optional 6" wide x 20' long (150 mm x 6 m) rolls

- FastWrap+: 25' (7.6 m) standard length, 48" (1220 mm) wide blanket helps to minimize waste
- Aluminum foil tape
- Minimum ¾" (19.0 mm) wide filament tape (optional)
- Carbon steel or stainless steel banding material, minimum ½" (12.5 mm) wide, minimum 0.015" (0.38 mm) thick, with steel banding clips
- Hand banding tensioner and crimping tool
- Minimum 12 gage steel insulation pins; galvanized steel speed clips, minimum 1½" (38 mm) x 1½" (38 mm) square or 1½" dia. (38 mm), or equivalent sized cup-head pins; capacitor discharge stud gun
- Access door hardware: four galvanized steel threaded rods, ¼" diameter (6.35 mm) by 4½" to 5" long (114 to 127 mm) with ¼" (6.35 mm) wing nuts and ¼" (6.35 mm) washers; 4" (102 mm) long steel tubing to fit threaded rods
- An approved silicone firestop sealant

Storage:

The FastWrap+ and an approved silicone firestop sealant must be stored in a dry warehouse environment on pallets. Pallets should not be stacked.

Preparatory Work:

FastWrap+ is installed with common tools, such as knives, banders and capacitor discharge guns for applying insulation pins. In order to install the duct fire stop system, the surfaces of all openings and penetrating items need to be clean, dry, frost free, and free of dust.

Installation techniques for Thermal Ceramics FastWrap+ (Figures 1 and 3):

- **3" (75 mm) Overlap Wrap Telescope** - Each blanket overlaps one adjacent blanket, and each blanket has one edge exposed and one edge covered by the next blanket as shown in Figures 1 and 3. The visible edges of the longitudinal overlaps all point in the same direction.
- **Overlap Checkerboard Pattern** - Blankets with both edges exposed alternate with blankets with covered edges, as shown in Figures 1 and 3. The visible edges of the longitudinal overlaps

alternate their directions and appear on every other blanket.

- **Butt Joint & Collar System** - Adjacent blankets are butted tightly together and a 6" (152 mm) wide collar of FastWrap+ is centered over the joint, overlapping each blanket by 3" (75 mm) as shown in Figures 1 and 3.

- **2 & 3 Sided Enclosure System** - When space does not allow for full wrap enclosure on all four sides of the duct, the FastWrap+ may be installed on 2 or 3 sides of the duct and mechanically attached to a concrete or CMU assembly on the unexposed side of the duct.

General:

To minimize waste, material should be rolled out tautly before measuring. Cut edges of the blanket shall be taped with aluminum foil tape to prevent exposed edges of the insulation from wicking moisture from condensation or grease from a compromised leaking duct joint into the material and causing degradation of the fire barrier. The FastWrap+ material may be installed with either a mechanical banding system or insulation pins and clips (see Mechanical Attachment Methods below and Figures 1 and 3). When using the banding technique, caution shall be taken to ensure that the bands are not fitted too snug as which could result in cutting into the blanket. To prevent blanket sag on ducts with dimensions greater than or equal to 24" (600 mm), insulation pins, long enough to extend through the layers of blanket insulation, are welded to the duct in columns spaced 12" (305 mm) apart, between 6" and 12" (152 and 305 mm) from each edge and 10½" (267 mm) on center along the bottom horizontal and outside vertical duct runs. Insulation pins that extend beyond the blanket wrap shall be tuned down to eliminate sharp points. Support hanger systems do not need to be wrapped provided that the steel hanger rods are at least a minimum of ⅜" (9.5 mm) diameter and the steel angle is a minimum of 1½" x 1½" x ⅛" (38 mm x 38 mm x 3.2 mm), or SMACNA equivalent support system (SMACNA band strap support systems do not apply). Horizontal trapeze support systems may be incorporated into the wrap enclosure.

A. Overlap Wrap Telescope Installation

FastWrap+ commercial kitchen grease or air ventilation duct 1 or 2 hour enclosure includes a one-layer wrap construction applied directly to all surfaces of the duct (Figures 1 and 3). The FastWrap+ blanket is wrapped one layer 1½" (38.1 mm) or 2" (50 mm) thick around the perimeter of the duct with a length cut to provide enough excess to overlap itself not less than 3" (75 mm). Adjacent blankets are placed to overlap the previous blanket not less than 3" (75 mm). The overlap made by adjacent blankets forms the "longitudinal" overlap. The overlap a blanket makes with itself is called the "perimeter" overlap. The wrap layer may be held temporarily in place with filament tape 1½" (38 mm) from each blanket edge and in the center of the blanket until the mechanical banding or pinning and clip attachment method is secured.

B. Checkerboard Wrap Installation

FastWrap+ is cut to completely wrap around the perimeter of the duct with enough excess to provide an overlap of not less than 3" (75 mm) (Figures 1 and 3). The blankets with both edges exposed alternate with blankets with covered edges as shown in Figures 1 and 3. The visible edges of the longitudinal overlaps alternate their directions and appear on every other blanket. A 3" (75 mm) longitudinal overlap is installed onto the previous adjacent wrap forming a "checkerboard" construction. The wrap layer may be held temporarily in place with filament tape 1½" (38 mm) from each blanket edge and in the center of the blanket until the mechanical banding or pinning and clip attachment method is secured.

C. Butt Joint / Collar Installation

FastWrap+ is installed in a single layer directly to the duct with a tight butt joint construction (Figures 1 and 3). The FastWrap+ material may be held in place with filament glass tape 1½" (38 mm) from each blanket edge and in the center of the blanket temporarily until the mechanical banding or pinning and clip attachment method is secured. A 6" (152 mm) wide FastWrap+ Collar is centered over the joints overlapping on each side of the blanket joint 3" (75 mm).

D. 2 & 3 Sided Wrap System

When space does not allow for a complete wrap applied to the duct on all four sides, the FastWrap+ can be installed in a single layer on the 2 or 3 sides of the unexposed duct and mechanically attached to a concrete or CMU assembly. The FastWrap+ is installed on the duct as described in one of the three installation methods described above with the starting edge of the blanket attached to the concrete or CMU assembly and then wrapped around the duct until the other end can be affixed to the other concrete or CMU assembly, thus encapsulating the duct with insulation around all accessible sides. The blanket is to flange out onto the concrete or CMU assembly. It should be secured to the adjoining assembly with minimum ¾" (4.7 mm) diameter, 4" (100 mm) long concrete anchors, footed to a minimum 1½" (38 mm) wide x ¾" (4.7 mm) thick steel strip/strap with pre-drilled holes spaced a maximum 10" (254 mm) on center. The FastWrap+ insulation wrap is secured to the duct with banding (see Mechanical Attachment Methods for Insulation Wrap section below or Figures 1 and 3). The ends of the banding are to loop into the steel strips/straps that foot the blanket to the concrete floor or wall, and are tightened down. The trapeze support system may be incorporated within the wrap system.

Mechanical Attachment Methods for Insulation Wrap

1. Banding - ½" (12.7 mm) wide carbon steel or stainless steel banding, 0.015" (0.376 mm) thick, is placed around the entire perimeter of the insulated duct with maximum 10½" (267 mm) spacing centers and 1½" (38 mm) from each blanket edge or 1" (25 mm) from each collar edge when using the butt joint and collar method. When banding, filament tape can be used to temporarily hold the blanket in place until the banding is applied. The banding is placed around the material and tightened so as to firmly hold the FastWrap+ in place against the duct, but not cause any cutting or damage to the blanket.

2. Pinning - Min. 12 gage, 5" long (125 mm) steel insulation pins are welded to the duct at all blanket overlap locations (see Figures 1 and 3) spaced in rows max. 10½" (267 mm) on center and maximum 8" (200 mm) apart. An insulation pin is located in the middle of the perimeter overlap and center spaced between the pins. Pins are locked into place with 1½" (38 mm) diameter square or round, galvanized steel, speed clips or cup head pins. Pins that extend beyond outer blanket wrap layer shall be turned down to eliminate sharp edges or the excess length cut off.

NOTE: Pinning is required for grease ducts larger than 24" x 48".

Through-Penetration Firestop System

When the duct penetrates a concrete or drywall fire rated wall, ceiling, or floor, an approved fire stop system must be employed. (Figures 2 and 4). FastWrap+ approved through penetration fire stop systems are listed in Section 4, Specifications.

To fire stop the through penetration void area, cut strips of FastWrap+ 4½" (106 mm) wide and as long as the opening and install at a minimum 50% compression. Install the strips so that they are recessed ¼" (6.35 mm) from the top surface of the wall or floor. Install a minimum ¼" (6.35 mm) depth of an approved silicone firestop sealant into the opening to the recess around the top surface of the floor or wall through-penetration opening.

Grease Duct Access Door Installation

Four galvanized steel threaded rods, ¼" diameter (6.35 mm) by 4½" to 5" long (114 to 125 mm) are welded to the duct at the corners of the door opening. Four 5" (125 mm) long 12 gage insulation pins are welded to the door panel for installation of the blanket. Two layers of FastWrap+ are installed on the door. The first layer is cut and placed on the pins and over the access opening with a ½" (13 mm) overlap. When the door is installed, this first layer is compresses and fitted against the wrap surrounding the door opening to form a tight butt joint. The second layer is centered over the first piece so that a minimum 1" (25 mm) overlap exists around the perimeter. It is essential that this layer fit tightly against the wrap surrounding the access door opening with no through openings. The second layer is impaled over the pins and both layers are locked in place with speed clips. Pins that extend beyond the outer layer of FastWrap+ shall be turned down to avoid sharp points on the door.

The insulated door panel and the steel tubes are placed over the threaded rods and held in place with washers and wing nuts. The steel tubes hold the door to the duct and protect the wrap from damage as the door is removed. Alternatively, insulated pre-fabricated access doors are available from dealers. See the Thermal Ceramics FastWrap+ Design and Installation Manual for complete installation and drawing details.

8. Maintenance

No maintenance is required when installed in accordance with Thermal Ceramics installation instructions. Once installed, if any section that is greater than 8" x 8" is damaged or if the overlap area is damaged, the following procedures will apply:

- The damaged section should be removed by cutting the steel banding or removing the clips holding it in place
 - A new section of the same dimension should be cut from a roll of FastWrap+, either 24" (610 mm) or 48" (1220 mm) wide. Cut edges of the blanket shall be taped to prevent exposed edges of the insulation from wicking moisture or grease into the material and degradation of the fire barrier
 - The new section should be placed per Thermal Ceramics manufacturer's Installation Instructions ensuring the same overlap that existed previously
 - The steel banding should be placed around the material and tensioned so as to sufficiently hold the FastWrap+ in place without cutting the blanket
 - If the blanket has not been damaged but the foil has ripped, seal the opening with aluminum foil tape
- For damaged areas less than or equal to 8" X 8" the following procedure may be used.
- The damaged section should be removed by cutting out a square or rectangular that includes the damaged area and does not exceed 8" in width or length.
 - A repair section should be cut from a section of FastWrap+ that is 1" wider and 1" longer than the damaged area that has been removed. Cut edges of the blanket shall be taped to prevent the exposed edges of the insulation from wicking moisture or grease into the material.
 - A single min. 12 Gauge insulation pin min. 3" long should be welded to the grease duct in the center of the repair area. (Note: Cup head pins may also be used.)
 - The repair section is to be centered on the opening and impaled upon the insulation pins. All overlaps should be tucked into the repair opening to provide a tight fitting joint. Insulation is held in place with a 1½" square or round galvanized or stainless steel speed clip or a minimum 1" diameter cup head pin. The excess portion of the pin shall be cut off and/or turned down to eliminate sharp edges.
 - The joint should be sealed using aluminum foil tape.

9. Limitations

- FastWrap+ shall be installed in accordance with Thermal Ceramics - Installation Instructions
- Multiple steel ducts in a single FastWrap+ enclosure system are not permitted for commercial kitchen grease ducts. Multiple steel ducts in a single enclosure are permitted for air ventilation ducts
- Grease Duct Sizes > 24"x48" (600 mm x 1200 mm) insulation is attached using steel pins
- Air Ducts: when maximum duct size dimensions are greater than 84" x 21" (2100 mm x 525 mm) in cross section, reinforce the duct with steel angles sufficient to support the total weight of the duct assembly and the FastWrap+ enclosure
- Minimum 3/8" (9 mm) diameter all thread steel rods do not have to be insulated
- Horizontal support members may be incorporated into the enclosure wrap
- The integrity of FastWrap+ system is limited to the quality of the installation

*For personal protective equipment recommendations see the MSDS.

Thermal Ceramics is a trademark of Morgan Crucible Company plc. and FastWrap are trademarks of Thermal Ceramics Inc. FastWrap products are manufactured by Thermal Ceramics Inc. Duct Systems are distributed by authorized distributors and no longer by 3M.

Tremco and Fyre-Sil are tradenames of Tremco Inc.

Pensil is a tradename of Specified Technologies Inc.

835+ is a tradename of Rectorseal.


FS One is a tradename of HILTI Inc.

Special Note:

The original FastWrap+ 2" technical data and installation sheet is still available electronically at www.thermalceramics.com in the data sheets section.



New and Improved 1 1/2" FastWrap+ Commercial Kitchen Grease or Air Ventilation Duct 1 or 2 Hour Shaft Alternative Zero Clearance to Combustibles

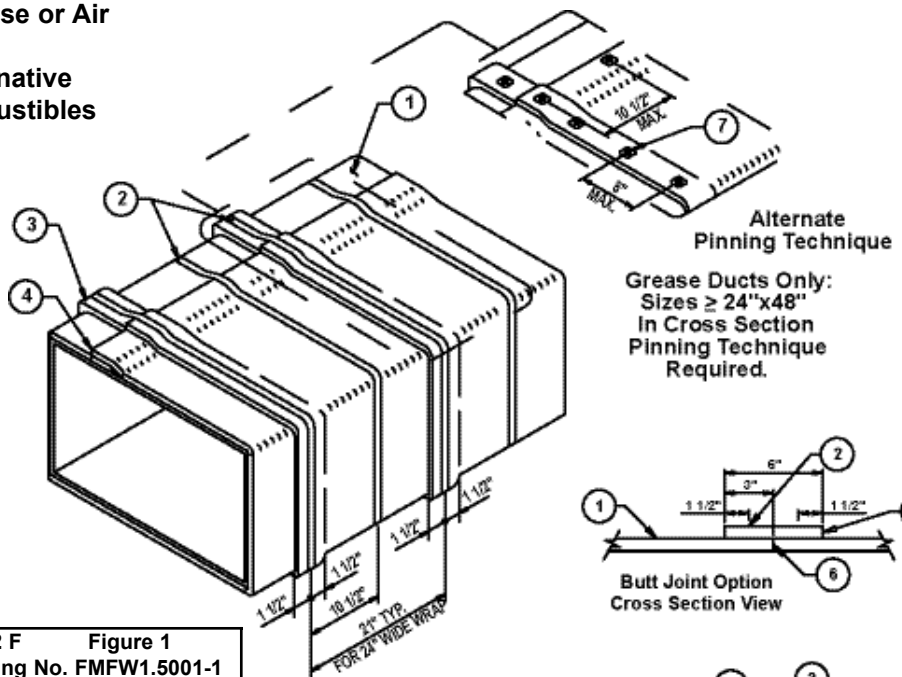


Grease Ducts Only:
Sizes $\geq 24'' \times 48''$
In Cross Section
Pinning Technique
Required.

OPL Design No. GD 544 F and GD 562 F Figure 1	
UL Design No. G-14 and V-19 Drawing No. FMFW1.5001-1	
1	One layer FastWrap+ 1 1/2" thick
2	Steel banding 1/2" wide minimum
3	3" minimum longitudinal overlap
4	3" minimum perimeter overlap
5	6" wide FastWrap+ collar (for Butt Joint option)
6	Firmly butted joint (for Butt Joint option)
7	10 or 12 gauge steel insulation pin with 1 1/2" x 1 1/2" or 1 1/2" diameter galvanized speed clips (for alternate pinning)

Note: The integrity of Duct Firemaster Product is limited to the quality of the installation.

**New and Improved 1½" FastWrap+ Through Penetration System
1 or 2 Hour
Grease or Air Duct**

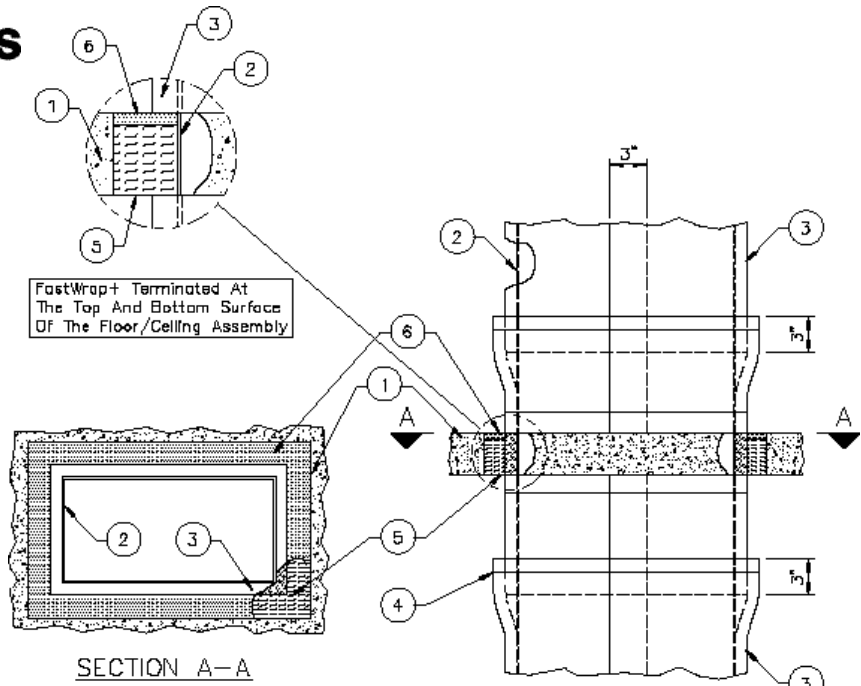

FastWrap+ Terminated At The Top And Bottom Surface Of The Floor/Ceiling Assembly

SECTION A-A


FastWrap+ Continuous Through The Floor/Ceiling Assembly

OPL Design No. FS 587 F Figure 2
UL Design Nos. C-AJ-7095, C-AJ-7098, W-L-7121, and F-C-7036 Drawing# FMFW1.5003-1

1	Floor/ceiling or wall assembly
2	Duct
3	One layer FastWrap+ 1½" thick
4	Steel banding ½" wide minimum or pinning
5	FastWrap+ (packing material)
6	Approved Through Penetration FireStop System

Note: The integrity of Duct Firemaster Product is limited to the quality of the installation.

New and Improved 1½" FastWrap+ Commercial Kitchen Grease Duct Access Door

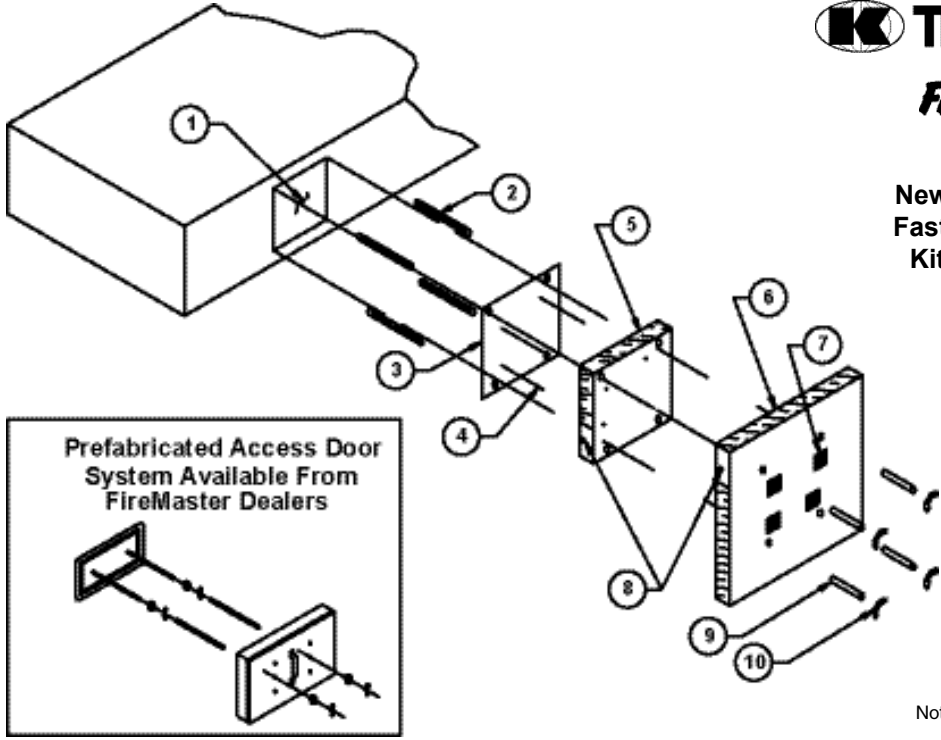


Note: The integrity of Duct Firemaster Product is limited to the quality of the installation.

OPL Design No. GD 544 F and GD 562 F Figure 3
UL Design No. G-14 and V-19 Drawing No. FMFW1.5001-1

1	Door hole	6	One layer FastWrap+ 1" overlap
2	¼" diameter all threaded rods	7	Speed clips
3	Access cover 16 gauge	8	Aluminum tape at edges
4	Insulation pins welded	9	Spool pieces for threaded rods
5	One layer FastWrap+ 1½" thick	10	¼" diameter wing nuts

**New and Improved 1½" FastWrap+ Commercial Kitchen Grease Duct
Typical Insulation Pin Layout for Duct Spans ≥ 24" Wide to Prevent Blanket Sag**

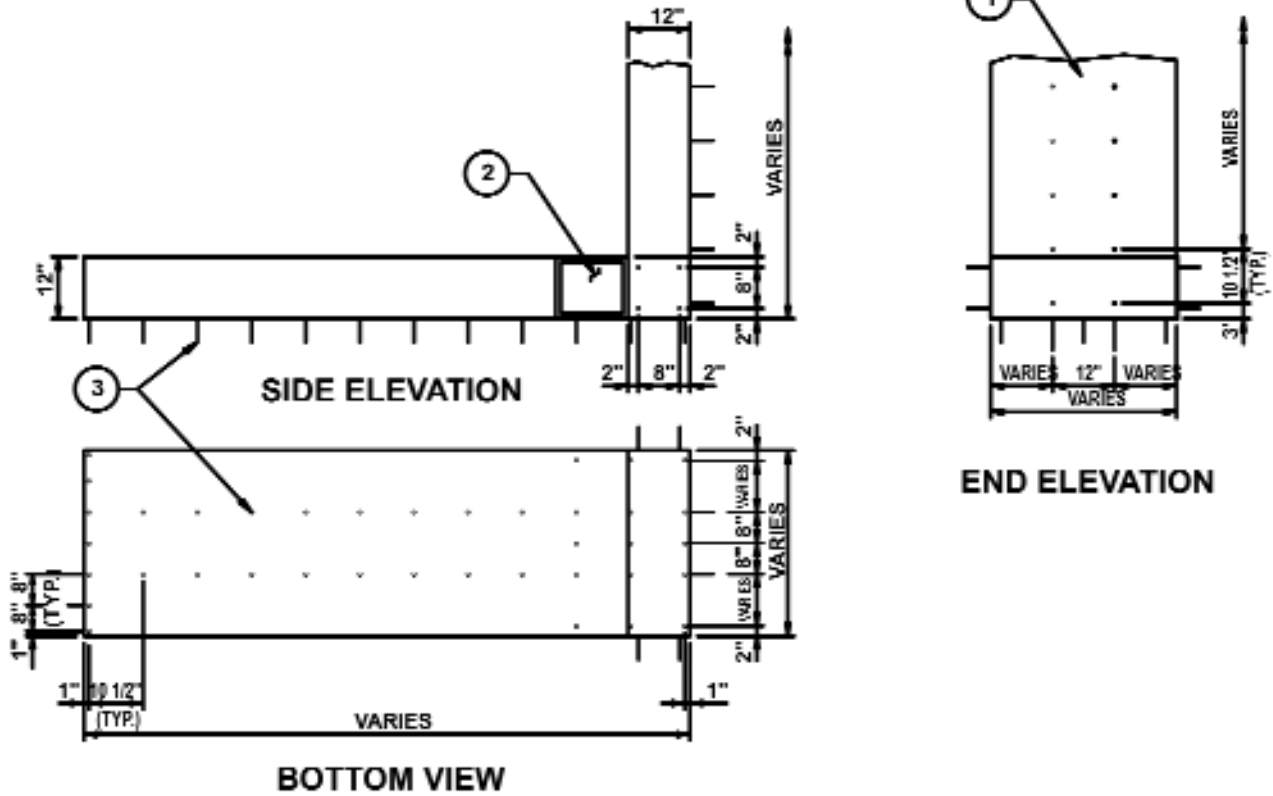

Installation Pin Layout		Figure 4
		Drawing No. FMFW1.5004
1	Vertical section	
2	Access door	
3	10 or 12 gauge steel insulation pin	

Note: The integrity of Duct Firemaster Product is limited to the quality of the installation.

Marketing Communications Offices
Thermal Ceramics Americas
 T: (706) 796 4200
 F: (706) 796 4398
Thermal Ceramics Asia Pacific
 T: +65 6733 6068
 F: +65 6733 3498
Thermal Ceramics Europe
 T: +44 (0) 151 334 4030
 F: +44 (0) 151 334 1684

North America - Sales Offices
Canada
 T: +1 (905) 335 3414
 F: +1 (905) 335 5145
Mexico
 T: +52 (555) 576 6622
 F: +52 (555) 576 3060
United States of America
 Eastern T: (800) 338 9284 F: (706) 796 4324
 Western T: (866) 785 2738 F: (866) 785 2760

South America - Sales Offices
Argentina
 T: +54 (11) 4373 4439
 F: +54 (11) 4372 3331
Brazil
 T: +55 (21) 2418 1366
 F: +55 (21) 2418 1205
Chile
 T: +56 (2) 854 1064
 F: +56 (2) 854 1952

Colombia
 T: +57 (2) 2282935/2282803/2282799
 F: +57 (2) 2282935/2282803/23722085
Guatemala
 T: +50 (2) 4733 295/6
 F: +50 (2) 4730 601
Venezuela
 T: +58 (241) 878 3164
 F: +58 (241) 878 6712